


ELECTRICAL CONSIDERATIONS FOR MEDICAL LOCATIONS

Electrical requirements
for Medical Locations- Workshop


‘Life after MEIGaN’

Presented by:

Paul Harris

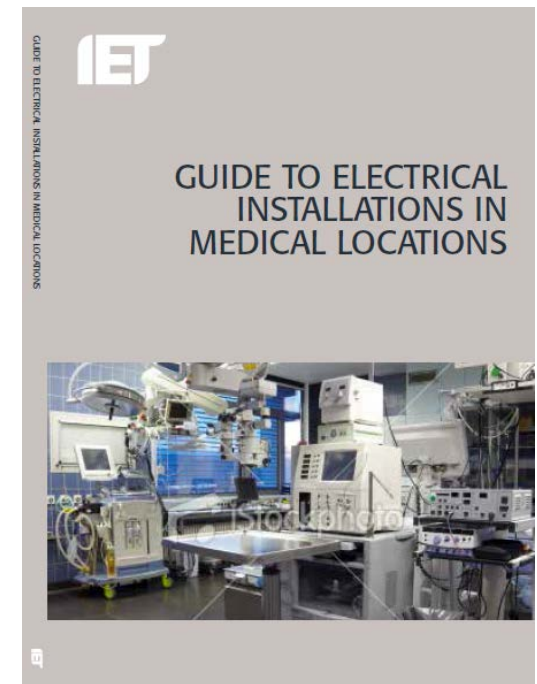

Hierarchy of Documents

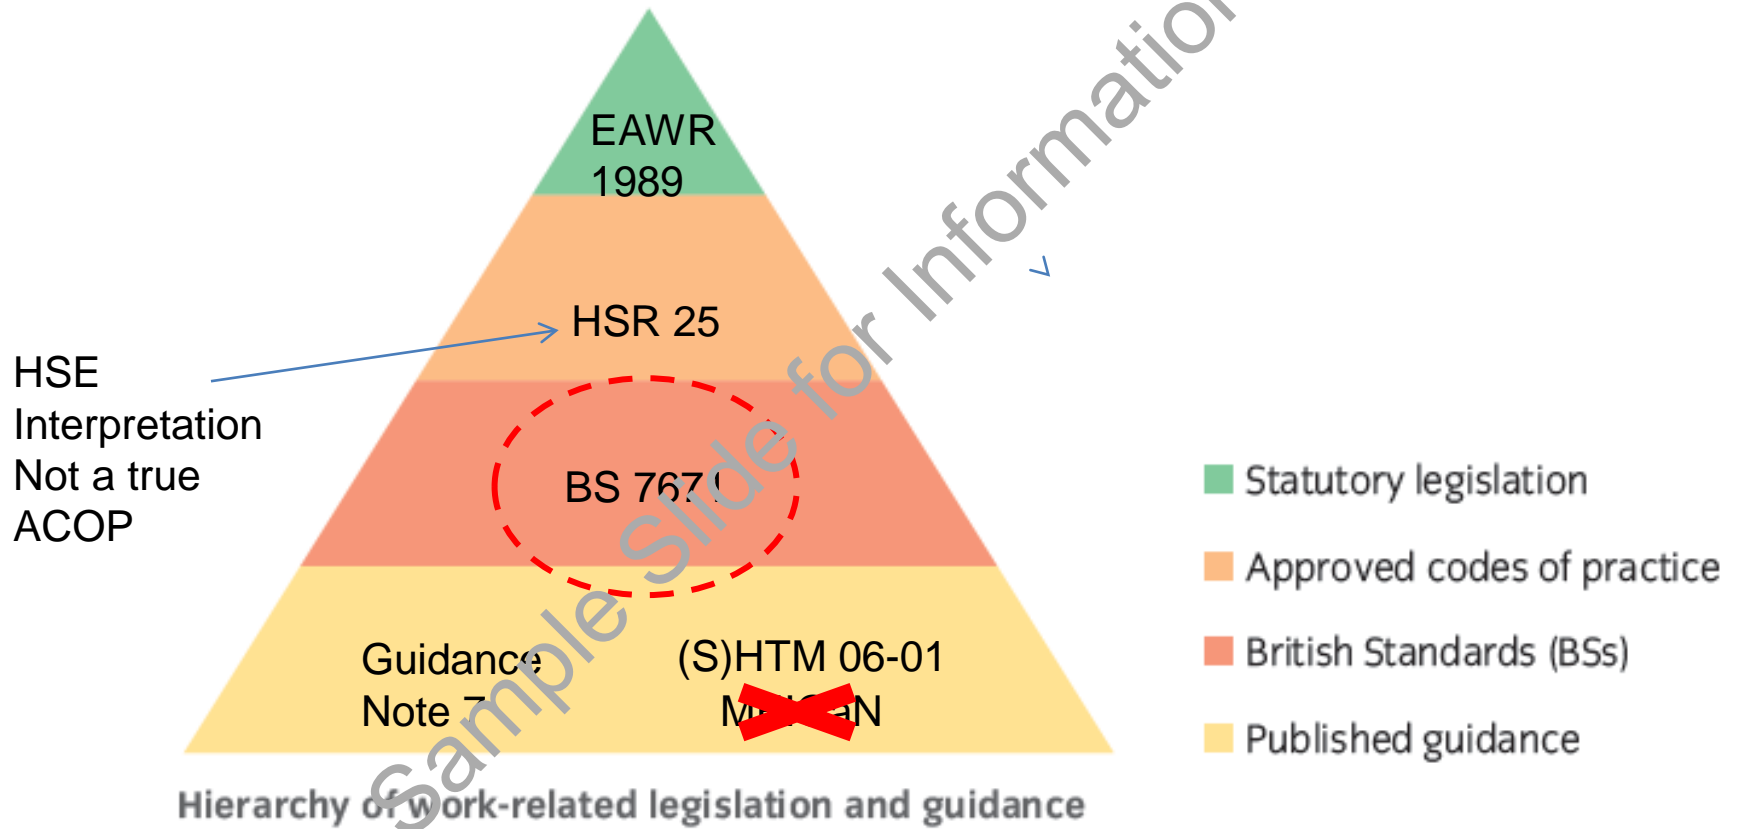

BS 7671 Section 710 Medical Locations

First published In BS 7671 2008 (2011) amended June 2013
incorporated into BS 7671 2008 (2015)

Section 710 scope applies to:

- hospitals
- private clinics
- medical and dental practices
- healthcare centres
- dedicated medical rooms in the work place
- veterinary clinics



Medical locations- Periodic Inspection

Guidance Note 3

Hospitals and medical clinics			
Hospitals and medical clinics – general areas	1 year	5 years	1, 2
Hospitals and medical clinics – medical locations	6 months	1 year	9

Notes:

- 1** Particular attention must be taken to comply with SI 2002 No. 2665 – Electricity Safety, Quality and Continuity Regulations 2002 (as amended).
- 2** Electricity at Work Regulations 1989, Regulation 4 and Memorandum of guidance (HSR 25) published by the HSE.
- 9** Medical locations shall have their isolating transformer equipment inspected and tested for functionality as well as alarms etc.; every third year the output leakage current of the IT isolating equipment shall be measured.